


TYBOX 31 - TYBOX 61



www.deltadore.com

Important product
information (4)

	2 x 1,5V LR03 - AAA Alkaline
Class	
	2 A max., 230V~ (Type 1.C)
°C	-5°C / +40°C
	80 x 103 x 25 mm
IP	IP 30
CE	2014/30/UE - 2014/35/UE

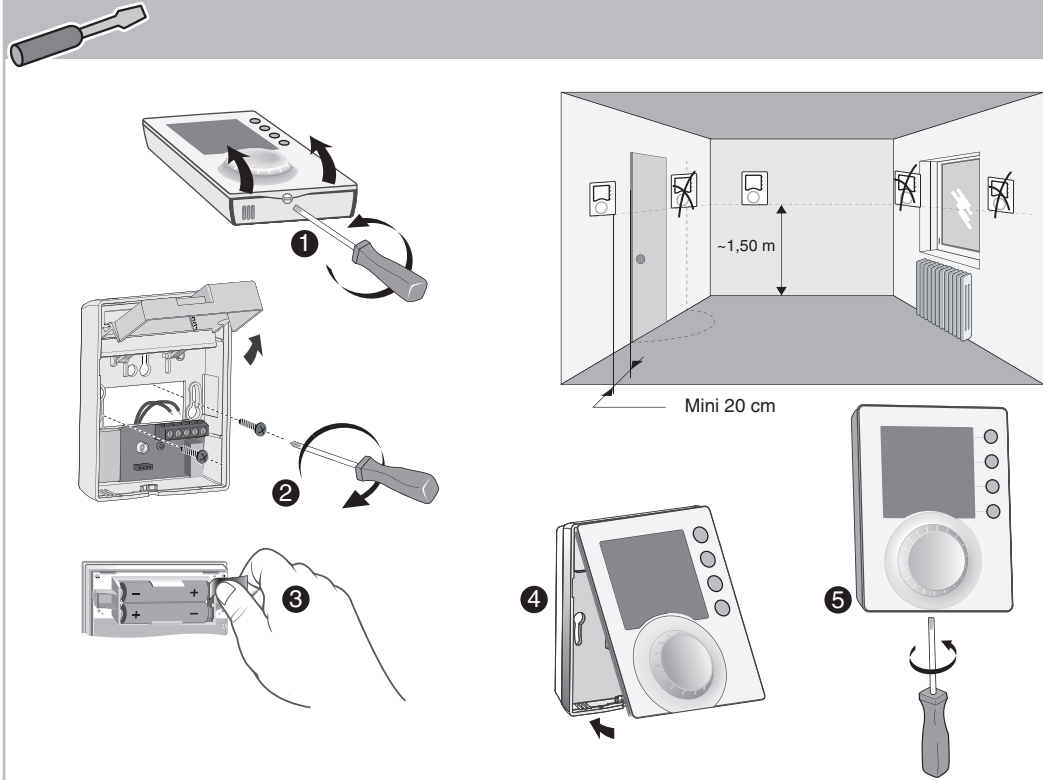


TYBOX 31

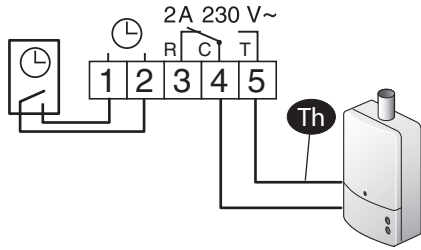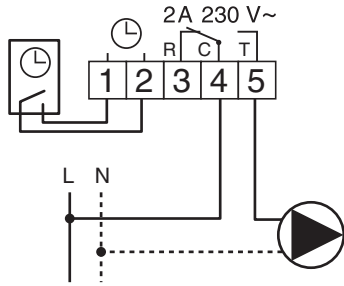


Th Entrée thermostat / Thermostat input /
Entrada termostato / Entrada do termostato /
Ingresso termostato / Thermostat-eingang /
Wejście dla termostatu / Thermostaatingang /
Termostat vstupní / Termostat ingång /
Termostat input / Termostat inngang /
Termostaatti tulo / 温控器输入

TYBOX 61

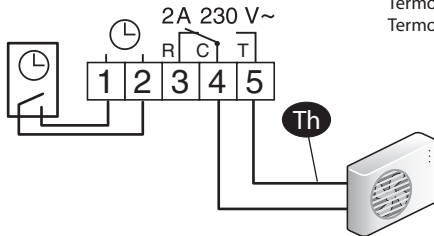

MENU 1

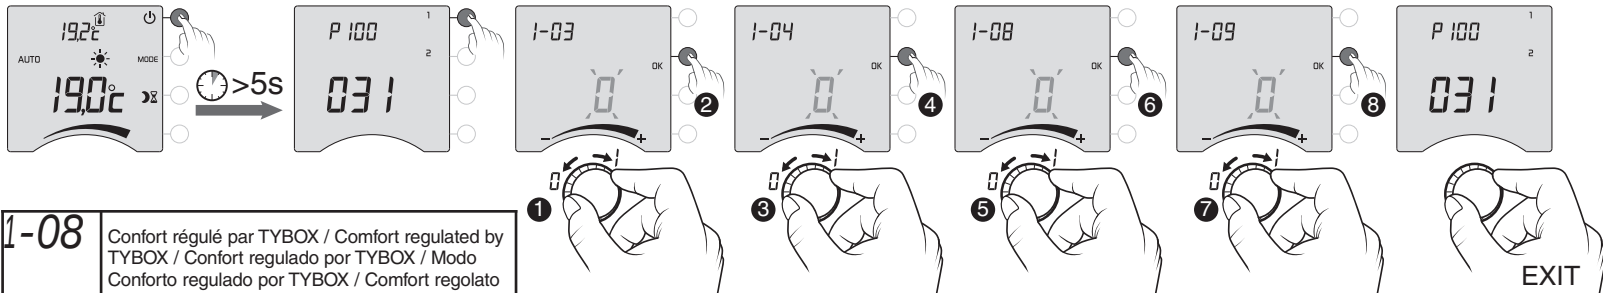

1-03	Présence programmeur (☹) / Programmer present / Presencia programador / Presença de programador / Presenza programmatore / Vorhandenes Programmiergerät / Programator dostępny / Aanwezigheid programmeerklok / Přítomnost programátora / Programmerare existerar / Tilstedeværelse programmør / Programmator til stede / Ajastin / 编程器的存在
1-04	Configuration entrée ⌚ / Configuration input / Configuración entrada / Configuração de entrada / Configurazione ingresso / Einstellung des Eingangs / Konfiguracja wejście / Configuratie ingang / Konfigurace vstupu / Entré-inställningar / Indkæst konfiguration / Inngangskonfigurasjon / Saapumisasetukset / 输入口设置

1-08	Confort réglé par TYBOX / Comfort regulated by TYBOX / Confort regulado por TYBOX / Modo Conforto regulado por TYBOX / Comfort regolato mediante TYBOX / Komforteinstellung über den TYBOX / Regulacja komfortu przez TYBOX / Komfort geregeld door TYBOX / Komfort regulovaný TYBOX / Komfort reglerad av TYBOX / Komfort reguleret af TYBOX / Komfort regulert av TYBOX / Lämpötilan säätely TYBOXilla / 通过TYBOX调节的舒适状态
1-09	Anti-grippage / Anti-seizing / Antigripado / Antigripagem / Antigrippaggio / Festlaufschutz / System zapobiegający blokowaniu się pompy / Antiblokkering / Proti zadření / Anti-friktion / Anti-rivning / Antiblokkering / Kiertovesipumpun kiinnijuttumisen esto / 防卡

1-03	0	No
	1	Yes


1-08	0	Yes
	1	No

1-04	0	
	1	

1-09	0	No
	1	Yes



MENU 2

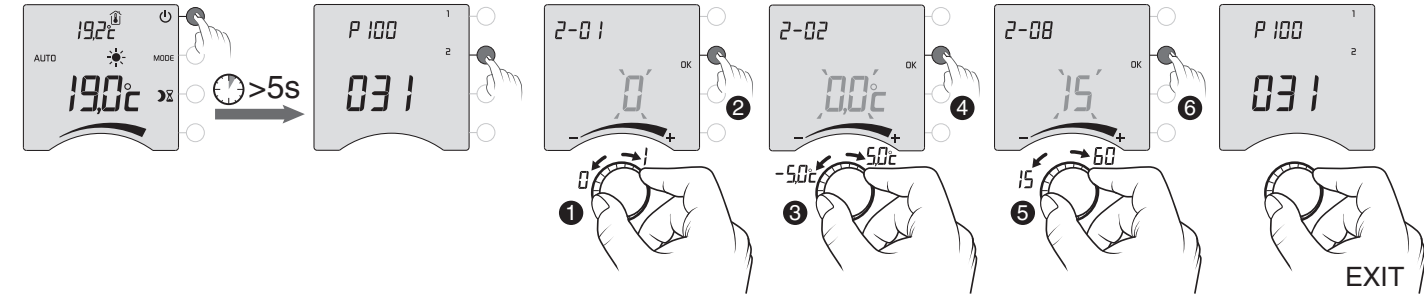

2-01	Limitation consignes / Settings limitation / Limitación consignas / Limitação de recomendações / Limitazione valori di riferimento / Begrenzung der Sollwerte / Ograniczenie wartości zadane / Beperking ingestelde temperatuur / Omezení - pokyny / Anvisningsbegränsningar / Begrænsning indstillingsværdier / Begrensning i instruksene / Ohjearvojen rajoitus / 温度设定限制
2-02	Correction température mesurée / Measured temperature correction / Corrección temperatura medida / Correção da temperatura medida / Correzione temperatura misurata / Korrektur der gemessenen Temperatur / Korekta zmierzanej temperatury / Aanpassen gemeten temperatuur / Korekce měřené teploty / Uppmätt temperaturkorrigering / Korrektion målt temperatur / Korreksjon av målt temperatur / Mitatun lämpötilan korjaus / 测量出的温度的校正

2-08	Base de temps de régulation / Regulation time base / Base de tiempos de regulación / Base de tempo de regulação / Base di tempo di regolazione / Zeitbasis für die Einstellung / Podstawa czasu regulacji / Basis voor instellingstijd / Báze doby regulace / Bas för inställningstid / Tidsbasis for regulering / Tidsenhet for regulering / Lämpönsäätelyn aikayksikkö / 调节时基
------	---

2-01	0	
	1	

2-08	15	Minutes (TYBOX 31)
	30	Minutes
	45	Minutes
	60	Minutes (TYBOX 61)

2-02	-5°C <	> +5°C
------	--------	--------

